



SEMINOLE GENERATING STATION INCREMENT ONE LANDFILL ANNUAL GROUNDWATER MONITORING AND CORRECTIVE ACTION REPORT

January 31, 2025

Seminole Electric Cooperative, Inc. (Seminole) operates the Increment One landfill (Increment One) at its Seminole Generating Station in Palatka, Florida. Seminole monitors four downgradient and three background groundwater monitoring wells pursuant to the Coal Combustion Residuals Rule¹ (CCR Rule); specifically, the groundwater monitoring program requirements of 40 CFR Sections 257.90-257.98. This report has been prepared in accordance with Section 257.90(e).

In 2024, Seminole operated the CCR unit groundwater monitoring under the detection monitoring program in Section 257.94. Per the program requirements, Seminole collected and analyzed groundwater samples taken during two separate detection monitoring events.

The first detection sampling event occurred March 12, 2024, for MW-3A and MW-5A. Seminole collected samples from MW-19 - MW-21 on March 13, 2024, and from MW-22 and MW-41AR on March 19, 2024. Inadvertently, confirmatory samples were not collected for this sampling event.

Statistically significant increases over background were determined to have occurred as outlined in the table below:

| | |
|------------------------|----------------------------|
| Boron | MW-19, MW-20, MW-21, MW-22 |
| Calcium | MW-19, MW-20, MW-21, MW-22 |
| Chloride | MW-19, MW-22 |
| Sulfate | MW-19, MW-20, MW-21, MW-22 |
| Total Dissolved Solids | MW-19, MW-20, MW-21, MW-22 |
| pH | MW-22 |

The second sampling event occurred on October 1, 2024, for MW-3A, MW-5A, and MW-19. MW-20 – MW-22 and MW-41AR were sampled October 2, 2024. Confirmatory results were collected December 9 for MW-20 and MW-21, and December 10 for MW-19 and MW-22.

¹ Title 40 Code of Federal Regulations Part 257 (40 CFR 257), Subpart D – Standards for the Disposal of Coal Combustion Residuals in Landfills and Surface Impoundments

Statistically significant increases over background were determined to have occurred as outlined in the table below:

| | |
|------------------------|----------------------------|
| Boron | MW-19, MW-20, MW-21, MW-22 |
| Calcium | MW-19, MW-20, MW-21, MW-22 |
| Sulfate | MW-19, MW-20, MW-21, MW-22 |
| Total Dissolved Solids | MW-19, MW-20, MW-21, MW-22 |
| pH | MW-22 |


A table containing the monitoring data obtained during all detection monitoring events is attached.

An Alternate Source Demonstration was completed on April 13, 2018. The Alternate Source Demonstration concluded that “there are multiple lines of evidence that alternate sources are the reason for constituents in groundwater above SSIs at Increment 1.” The Alternate Source Demonstration is re-verified following collection of verification samples for each sampling event. Based on these findings, Seminole will continue to operate under the detection monitoring program in Section 257.94.

No wells were decommissioned or installed related to the CCR program in 2024. Seminole observed no issues with meeting the compliance requirements of the CCR Rule in 2024.

Key activities in 2025 include collection of two separate detection monitoring events in accordance with 40 CFR Section 257.94(b).

TABLES

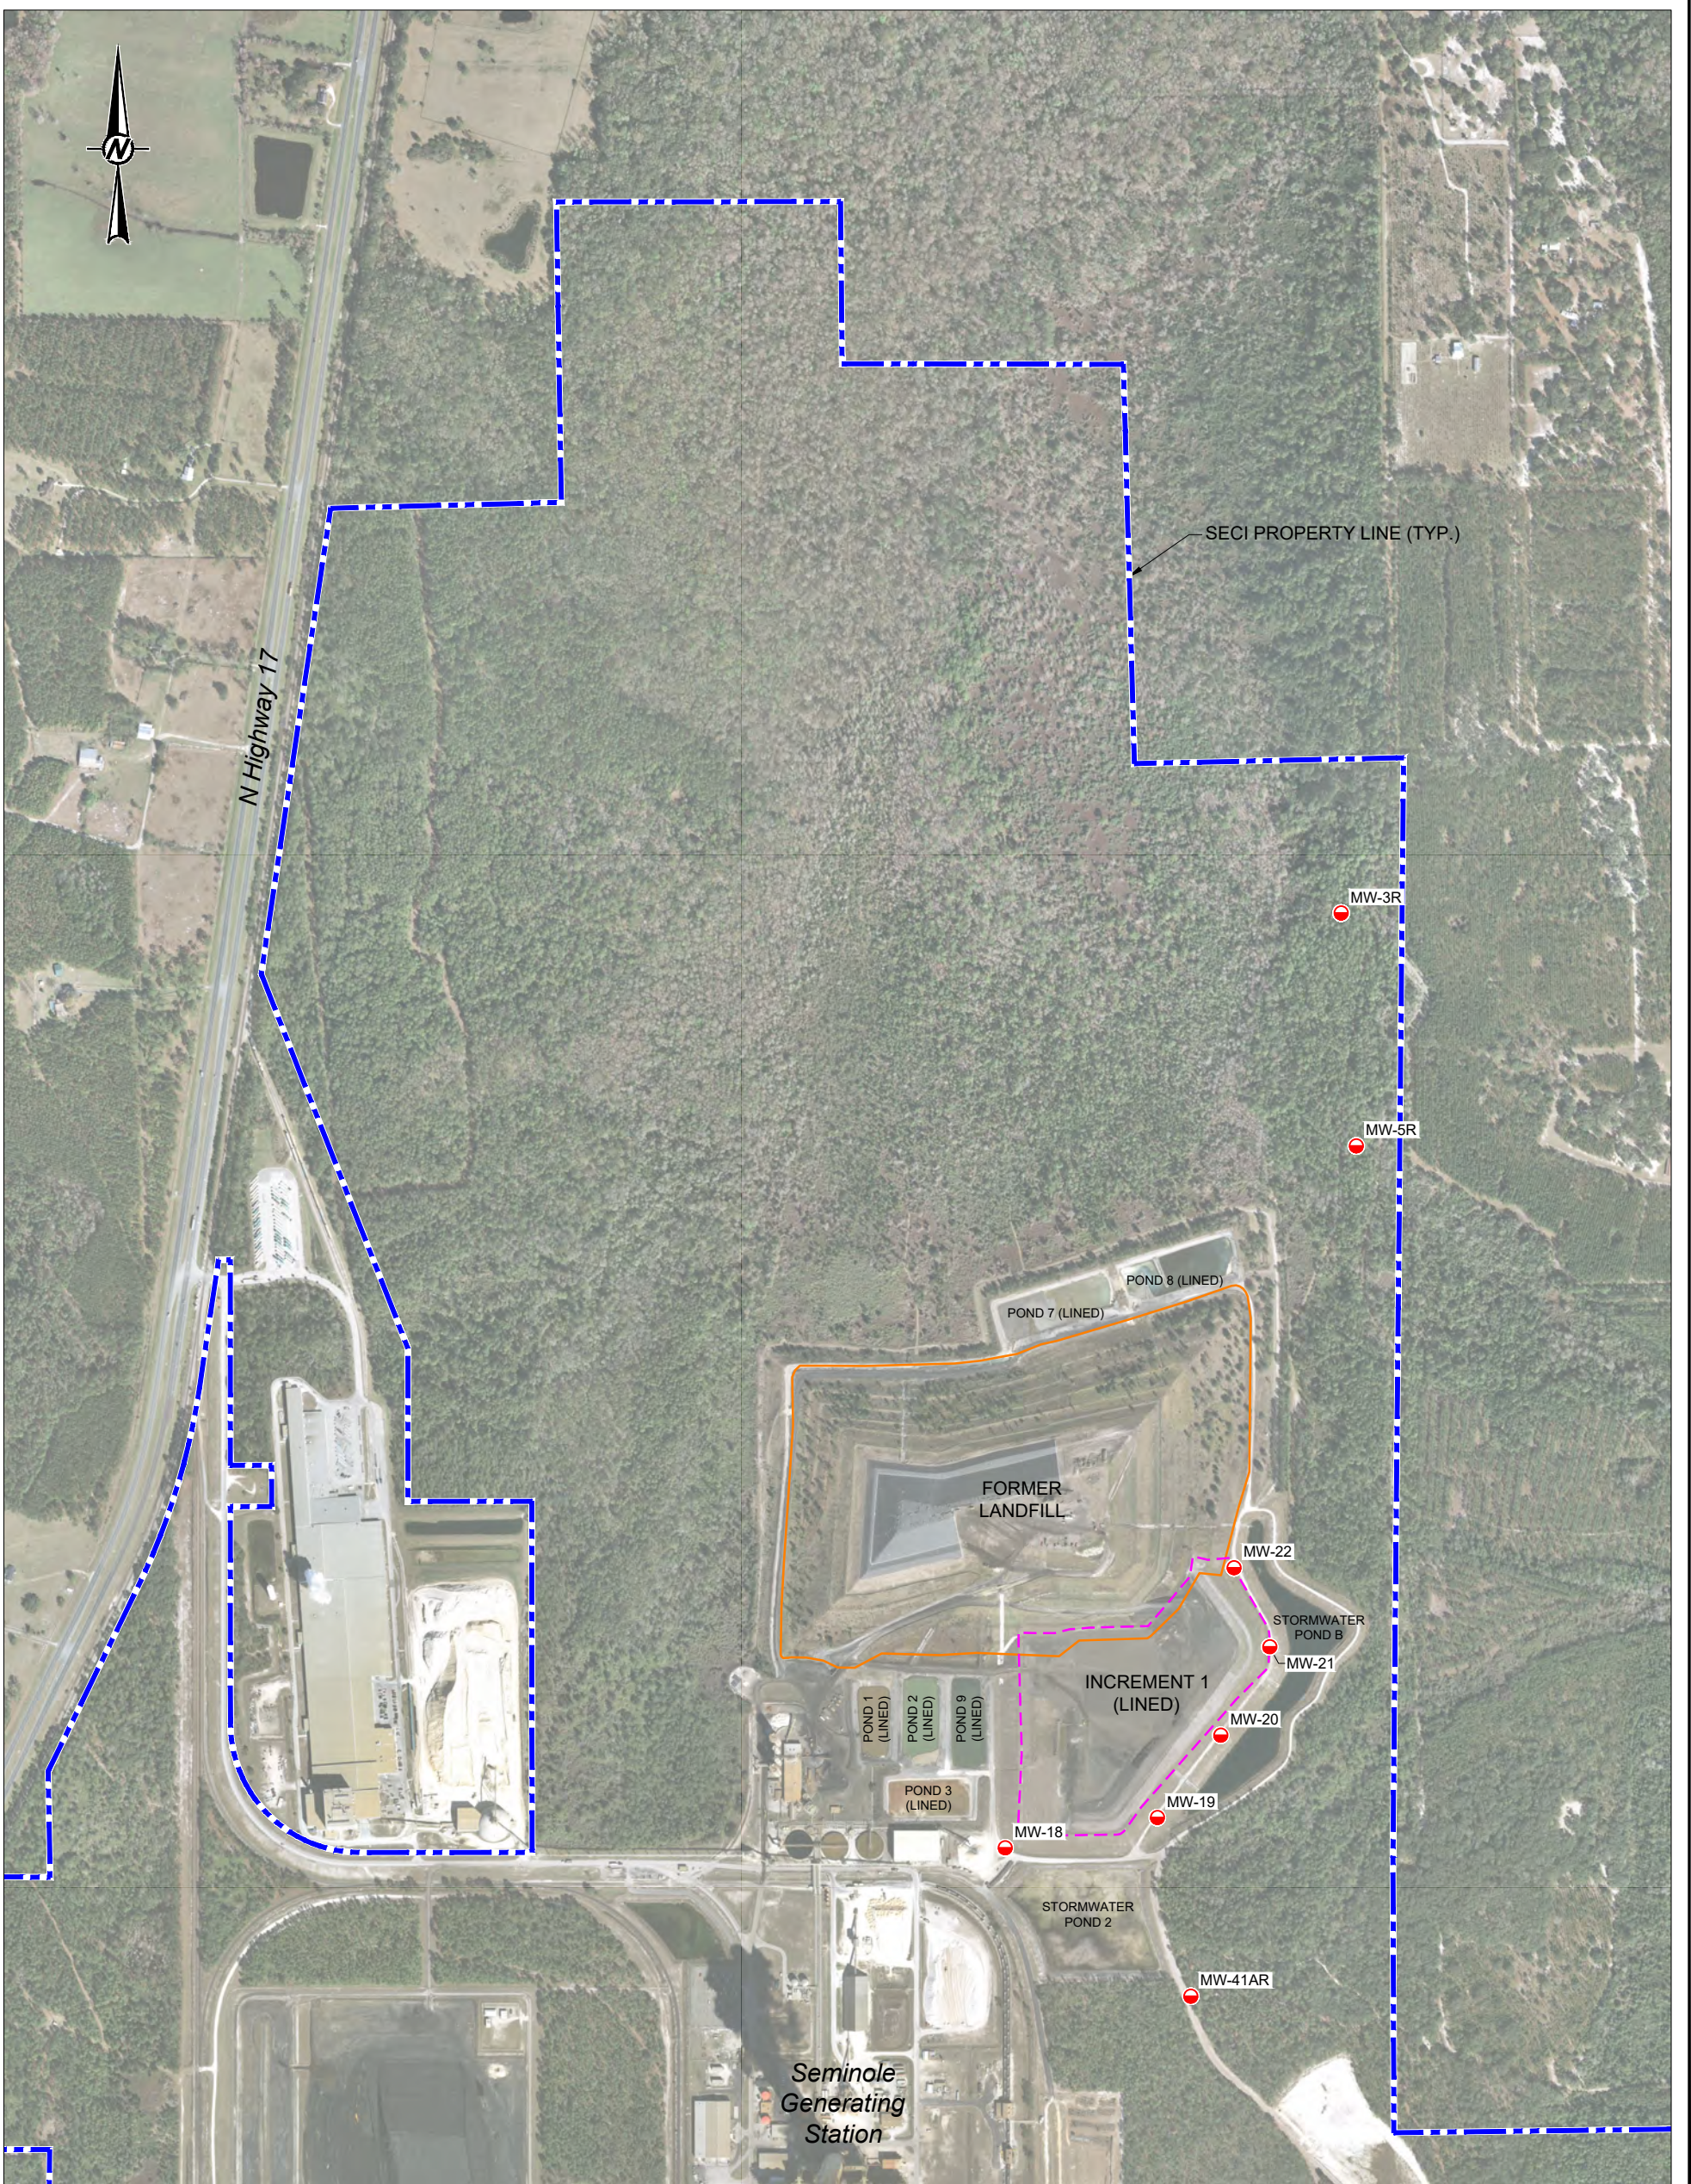

LEGEND

| | |
|--|--|
| | SECI PROPERTY |
| | APPROXIMATE LIMIT OF FORMER LANDFILL (ORIGINAL BOUNDARY) |
| | APPROXIMATE LIMIT OF INCREMENT 1 (LINED) |
| | MONITORING WELL LOCATION |

REFERENCE(S)
 BASE MAP DERIVED FROM HIGH-RESOLUTION IMAGERY. GRID CELLS 131657, 131658, 131659, 131957, 131958, 131959, 132257, 132258, & 132259; COURTESY OF FDEP LAND BOUNDARY INFORMATION SYSTEM (LABINS), www.labins.org, PHOTO DATE 2017.

CLIENT
 SEMINOLE ELECTRIC COOPERATIVE, INC.

| | | |
|------------|------------|------------|
| CONSULTANT | YYYY-MM-DD | 2019-05-09 |
| | DESIGNED | SFS |
| | PREPARED | BCL |
| | REVIEWED | SFS |
| | APPROVED | DG |

PROJECT
 SEMINOLE GENERATING STATION
 U.S. 17, PALATKA, FL

TITLE
INCREMENT I GROUNDWATER MONITORING WELLS



| | | | |
|--------------------------|------------------------------|--------------|--------------------|
| PROJECT NO. 19-116257 | Control No. 19116257-A001 | REV. ---- | FIGURE 1 |
|--------------------------|------------------------------|--------------|--------------------|

1. IF THIS MEASUREMENT DOES NOT MATCH WHAT IS SHOWN, THE SHEET SIZE HAS BEEN MODIFIED FROM: ANSI B

FIGURES

TABLE 1
DETECTION MONITORING LABORATORY RESULTS
Seminole Generating Station
Increment 1

| Monitoring Well | Sampling Date | Boron (µg/L) | Calcium (mg/L) | Chloride (mg/L) | Fluoride (mg/L) | pH (SU) | Sulfate (mg/L) | Total Dissolved Solids (mg/L) |
|-----------------|---------------|--------------|----------------|-----------------|-----------------|---------|----------------|-------------------------------|
| MW-3A | 10/13/2017 | 44 I | 1.07 | 10 | 0.01 I | 4.59 | 7.7 | 78 |
| | 3/15/2018 | 40 I | 1.18 | 11.5 | 0.02U | 4.06 | 10 | 38 |
| | 7/31/2018 | 31 I | 1.08 | 11.9 | 0.02 U | 4.78 | 7.2 | 58 |
| | 2/11/2019 | 29 I | 1.3 | 110 | 0.13 I | 4.32 | 6.3 | 63 |
| | 8/13/2019 | 24 I | 1.1 | 11 | 0.076 I | 4.4 | 7.4 | 63 |
| | 4/19/2020 | 100 U | 1.5 | 9.8 | 0.05 U | 4.69 | 11 | 81 |
| | 10/5/2020 | 100 U | 1.1 | 9.2 | 0.20 U | 4.51 | 8.2 | 54 |
| | 3/23/2021 | 100 U | 1.0 | 9.8 | 0.20 U | 4.5 | 6.6 I | 23 |
| | 12/2/2021 | 100 U | 1.9 | 9.8 | 0.20 U | 4.35 | 5.0 I | 35 |
| | 6/21/2022 | 100 U | 1.1 | 5.2 | 0.050 U | 4.59 | 2.2 I | 38 |
| | 11/2/2022 | 100 U | 1.4 | 11 | 0.20 U | 4.46 | 5.6 I | 53 |
| | 6/27/2023 | 100 U | 2.6 | 9.4 | 0.20 U | 4.62 | 4.6 I | 50 |
| | 10/11/2023 | 100 U | 1.1 | 7.8 I | 0.20 U | 4.56 | 5.4 I | 33 |
| | 3/13/2024 | 100 U | 1.1 | 9.9 | 0.20 U | 4.28 | 5.8 I | 66 |
| 10/1/2024 | 100 U | 1.1 | 10 | 0.20 U | 4.71 | 11 | 50 | |
| MW-5A | 10/13/2017 | 33 I | 8.88 | 17.9 | 0.08 I | 5.54 | 6.4 | 88 |
| | 3/15/2018 | 25 U | 7.72 | 17.3 | 0.05 I | 5.13 | 8.3 | 28 |
| | 7/31/2018 | 25 U | 8.73 | 19.5 | 0.08 I | 5.66 | 8.2 | 86 |
| | 2/11/2019 | 17 U | 7.4 | 110 | 0.077 I | 5.45 | 3.9 I | 76 |
| | 8/13/2019 | 20 U | 8 | 20 | 0.11 I | 5.58 | 5.8 | 96 |
| | 4/19/2020 | 100 U | 8.4 | 20 | 0.31 I | 5.6 | 7.2 | 83 |
| | 10/5/2020 | 100 U | 7.2 | 20 | 0.20 U | 5.48 | 6.8 I | 85 |
| | 3/23/2021 | 100 U | 6.8 | 19 | 0.20 U | 5.45 | 6.6 I | 65 |
| | 12/2/2021 | 100 U | 5.4 | 19 | 0.20 U | 5.37 | 6.3 I | 62 |
| | 6/21/2022 | 100 U | 6.0 | 9.7 | 0.050 U | 5.51 | 3.4 I | 63 |
| | 11/28/2022 | 100 U | 8.1 | 20 | 0.20 U | 5.39 | 6.9 I | 68 |
| | 6/27/2023 | 100 U | 6.8 | 21 | 0.20 U | 3.98 | 6.4 I | 85 |
| | 10/11/2023 | 100 U | 7.7 | 12 | 0.20 U | 5.59 | 8.1 | 69 |
| | 3/13/2024 | 100 U | 6.7 | 20 | 0.20 U | 5.4 | 8.3 | 82 |
| 10/1/2024 | 100 U | 6.4 | 100 U | 10 U | 5.58 | 100 U | 74 | |
| MW-41AR | 10/13/2017 | 77 | 7.43 | 6.6 | 0.03 I | 4.46 | 23.1 | 64 |
| | 2/23/2018 | 98 | 6.81 | 12.1 | 0.03 I | 4.23 | 28.5 | 55 |
| | 8/3/2018 | 97 | 5.8 | 13.9 | 0.03 I | 4.33 | 25.3 | 46 |
| | 2/11/2019 | 69 | 5.7 | 0.50 U | 0.050 U | 4.17 | 0.50 U | 74 |
| | 8/13/2019 | 52 I | 6.2 | 8.8 | 0.11 I | 4.37 | 24 | 67 |
| | 4/19/2020 | 150 I | 23 | 22 | 0.091 I | 6.12 | 44 | 100 |
| | 10/5/2020 | 100 U | 10 | 8.3 | 0.20 U | 5.08 | 28 | 63 |
| | 3/23/2021 | 100 U | 6.5 | 8.2 | 0.20 U | 4.55 | 19 | 65 |
| | 12/2/2021 | 100 U | 7.2 | 13 | 0.20 U | 4.50 | 25 | 83 |
| | 6/21/2022 | 100 U | 5.5 | 5.7 | 0.050 U | 4.78 | 10 | 61 |
| | 11/28/2022 | 100 U | 11 | 13 | 0.20 U | 4.82 | 29 | 68 |
| | 6/27/2023 | 100 U | 6.8 | 9.9 | 0.20 U | 5.51 | 19 | 69 |
| | 10/11/2023 | 100 U | 9.2 | 15 | 0.20 U | 5.12 | 23 | 71 |
| | 3/19/2024 | 100 I | 14 | 20 | 0.20 U | 4.72 | 44 | 95 |
| 10/2/2024 | 100 U | 11 | 16 | 0.20 U | 4.71 | 30 | 79 | |

TABLE 1
DETECTION MONITORING LABORATORY RESULTS
Seminole Generating Station
Increment 1

| Monitoring Well | Sampling Date | Boron (µg/L) | Calcium (mg/L) | Chloride (mg/L) | Fluoride (mg/L) | pH (SU) | Sulfate (mg/L) | Total Dissolved Solids (mg/L) |
|-----------------|---------------|--------------|----------------|-----------------|-----------------|---------|----------------|-------------------------------|
| MW-19 | 10/12/2017 | 1600 | 664 | 27.3 | 0.02 I | 6.09 | 1450 | 2640 |
| | 11/27/2017 | 7230 | 464 | 165 | -- | 5.74 | 1080 | 1900 |
| | 3/13/2018 | 1610 | 259 | 77 | 0.06U | 6.34 | 440 | 848 |
| | 5/4/2018 | 1910 | 375 | 79.1 | -- | 6.47 | 830 | 1360 |
| | 7/27/2018 | 3270 | 249 | 51.9 | 0.06 U | 5.34 | 595 | 1060 |
| | 9/14/2018 | 2340 | 214 | 31.9 | -- | 5.93 | 455 | 782 |
| | 2/8/2019 | 1500 | 610 | 120 | 0.21 I | 6.18 | 3.8 I | 2200 |
| | 4/4/2019 | 2500 | 520 | 59 | -- | 6.18 | -- | 1900 |
| | 8/12/2019 | 1500 | 250 | 43 | 0.34 I | 5.73 | 570 | 970 |
| | 10/25/2019 | 1500 | 220 | 40 | 0.25 U | 5.45 | 490 | 840 |
| | 4/19/2020 | 1100 | 170 | 63 | 0.1 U | 5.33 | 370 | 660 |
| | 8/7/2020 | 920 | 130 | 38 | -- | 6.02 | 260 | 600 |
| | 10/5/2020 | 930 | 180 | 30 | 0.40 U | 6.26 | 300 | 660 |
| | 12/4/2020 | 820 | 240 | 24 I | -- | 5.93 | 580 | 920 |
| | 4/2/2021 | 1600 | 290 | 64 | 1.0 U | 5.49 | 600 | 1100 |
| | 7/30/2021 | 740 | 280 | 16 | -- | 6.17 | 410 V | 840 |
| | 12/2/2021 | 2700 | 510 | 28 I | 2.0 U | 5.83 | 1100 | 1800 |
| | 1/11/2022 | 2700 I | 410 | 57 | -- | 5.48 | 990 | 1380 |
| | 6/27/2022 | 2100 | 280 | 47 | 1.0 U | 5.4 | 590 | 894 |
| | 8/30/2022 | 1100 | 180 | 29 I | -- | 6.21 | 330 | 664 |
| | 11/2/2022 | 1300 | 620 | 100 U | 10 U | 6.31 | 1400 | 2400 |
| | 11/30/2022 | 2100 | 540 | -- | -- | 6.24 | 1200 | 1800 |
| | 6/27/2023 | 1600 | 150 | 18 | 0.20 U | 5.61 | 180 | 640 |
| | 8/22/2023 | 1300 | 130 | 30 | 0.40 U | 5.96 | 290 | 590 |
| | 10/12/2023 | 1400 | 150 | 37 | 0.40 U | 5.48 | 360 | 620 |
| | 11/14/2023 | 1300 | 160 | 34 | -- | 5.63 | 390 | 670 |
| | 3/13/2024 | 1600 | 300 | 26 I | 2.0 U | 6.03 | 950 | 1600 |
| | 10/1/2024 | 490 | 150 | 5.8 I | 0.40 U | 6.66 | 230 | 530 |
| 12/10/2024 | 2400 | 540 | -- | -- | 6.13 | 960 | 1800 | |

TABLE 1
DETECTION MONITORING LABORATORY RESULTS
Seminole Generating Station
Increment 1

| Monitoring Well | Sampling Date | Boron (µg/L) | Calcium (mg/L) | Chloride (mg/L) | Fluoride (mg/L) | pH (SU) | Sulfate (mg/L) | Total Dissolved Solids (mg/L) |
|-----------------|---------------|--------------|----------------|-----------------|-----------------|---------|----------------|-------------------------------|
| MW-20 | 10/12/2017 | 332 | 102 | 4.5 | 0.02 I | 6.08 | 115 | 344 |
| | 12/1/2017 | 2680 | 442 | -- | -- | 6.12 | 949 | 1600 |
| | 3/13/2018 | 2820 | 591 | 17 | 0.2U | 6.03 | 1420 | 1910 |
| | 5/4/2018 | 2610 | 491 | -- | -- | 4.81 | 1320 | 1820 |
| | 7/27/2018 | 3180 | 440 | 152 | 0.06 U | 4.53 | 1050 | 1870 |
| | 9/14/2018 | 3050 | 408 | 107 | -- | 5.21 | 938 | 1600 |
| | 2/8/2019 | 1500 | 310 | 87 | 0.24 I | 5.97 | 3.3 I | 1100 |
| | 4/4/2019 | 1800 | 500 | 47 | -- | 5.73 | -- | 1800 |
| | 8/12/2019 | 2300 | 420 | 65 | 0.50 U | 5.26 | 960 | 1500 |
| | 10/25/2019 | 1900 | 380 | 54 | -- | 4.89 | 1100 | 1700 |
| | 4/19/2020 | 2500 | 500 | 110 | 1 U | 5.28 | 1100 | 1700 |
| | 8/7/2020 | 2500 | 360 | 89 | -- | 4.85 | 890 | 1600 |
| | 10/5/2020 | 1100 | 230 | 10 U | 1.0 U | 5.83 | 480 | 900 |
| | 12/4/2020 | 1600 | 290 | -- | -- | 5.49 | 760 | 1100 |
| | 4/2/2021 | 1300 | 320 | 10 U | 1.0 U | 5.15 | 760 | 1100 |
| | 7/30/2021 | 450 | 150 | -- | -- | 5.79 | 390 | 570 |
| | 12/3/2021 | 1700 | 350 | 78 I | 2.0 U | 5.15 | 940 | 1260 |
| | 1/11/2022 | 2000 I | 470 | 84 | -- | 5.24 | 1000 | 2020 |
| | 6/27/2022 | 2600 | 460 | 130 | 2.0 U | 5.04 | 990 | 1550 |
| | 8/30/2022 | 640 | 160 | 17 | -- | 5.99 | 260 | 549 |
| | 10/31/2022 | 1200 | 400 | 20 U | 2.0 U | 5.91 | 850 | 1300 |
| | 11/30/2022 | 1200 | 520 | -- | -- | 5.96 | 910 | 1600 |
| | 6/27/2023 | 2400 | 200 | 140 | 2.0 U | 4.68 | 970 | 1700 |
| | 8/22/2023 | 2000 | 340 | 92 | 2.0 U | 5.38 | 920 | 1400 |
| | 10/12/2023 | 2100 | 410 | 92 | 2 U | 4.79 | 1100 | 1500 |
| | 11/14/2023 | 2000 | 430 | 57 I | -- | 5.19 | 1100 | 1500 |
| | 3/13/2024 | 1000 | 390 | 14 I | 0.40 U | 5.89 | 950 | 1500 |
| | 10/2/2024 | 360 I | 130 | 4.0 U | 0.40 U | 6.27 | 230 | 460 |
| 12/9/2024 | 410 | 320 | -- | -- | 6.3 | 540 | 1000 | |

TABLE 1
DETECTION MONITORING LABORATORY RESULTS
Seminole Generating Station
Increment 1

| Monitoring Well | Sampling Date | Boron (µg/L) | Calcium (mg/L) | Chloride (mg/L) | Fluoride (mg/L) | pH (SU) | Sulfate (mg/L) | Total Dissolved Solids (mg/L) |
|-----------------|---------------|--------------|----------------|-----------------|-----------------|---------|----------------|-------------------------------|
| MW-21 | 10/12/2017 | 1570 | 254 | 4.4 I | 0.02 U | 6.20 | 475 | 896 |
| | 12/1/2017 | 962 | 228 | -- | -- | 5.94 | 501 | 855 |
| | 3/13/2018 | 4410 | 340 | 37.5 | 0.06U | 6.01 | 812 | 1220 |
| | 5/4/2018 | 3610 | 281 | 14.5 | -- | 5.94 | 720 | 1030 |
| | 7/31/2018 | 4210 | 351 | 29.3 | 0.06 U | 5.7 | 909 | 1430 |
| | 9/14/2018 | 3690 | 278 | 16.8 | NA | 5.53 | 662 | 1040 |
| | 2/8/2019 | 6000 | 410 | 92 | 0.050 U | 5.94 | 18 | 1500 |
| | 4/4/2019 | 4000 | 340 | 8.6 I | -- | 5.96 | -- | 1300 |
| | 8/12/2019 | 3400 | 430 | 5.0 U | 0.50 U | 5.91 | 970 | 1500 |
| | 10/25/2019 | 4900 | 530 | -- | -- | 5.57 | 1300 | 1900 |
| | 4/19/2020 | 2800 | 490 | 11 I | 1.4 I | 4.81 | 1300 | 1800 |
| | 8/7/2020 | 4300 | 460 | -- | 2.0 U | 5.39 | 1300 | 2000 |
| | 10/5/2020 | 6200 | 460 | 40 U | 4.0 U | 5.69 | 1200 | 2000 |
| | 12/4/2020 | 6000 | 440 | -- | -- | 6.04 | 1200 | 1700 |
| | 4/2/2021 | 2700 | 390 | 10 U | 1.0 U | 5.96 | 690 | 1200 |
| | 7/30/2021 | 6100 | 540 | -- | -- | 5.78 | 1300 | 1600 |
| | 12/3/2021 | 360 I | 150 | 4.0 U | 0.40 U | 5.47 | 390 | 594 |
| | 1/11/2022 | 900 | 210 | -- | -- | 5.47 | 470 | 719 |
| | 6/28/2022 | 2600 | 350 | 10 U | 1.0 U | 5.71 | 840 | 1060 |
| | 8/23/2022 | 6200 | 350 | -- | -- | 6.05 | 960 | 1420 |
| | 10/31/2022 | 960 | 220 | 4.2 I | 0.40 U | 5.87 | 470 | 800 |
| | 12/31/2022 | 4700 | 410 | -- | -- | 5.90 | 860 | 1500 |
| | 6/27/2023 | 4700 | 410 | 20 U | 2.0 U | 5.53 | 1100 | 1600 |
| | 8/22/2023 | 4100 | 370 | 10 U | 1.0 U | 5.70 | 990 | 1500 |
| | 10/12/2023 | 5300 | 430 | 20 U | 2.0 U | 5.54 | 1200 | 1700 |
| | 11/15/2023 | 7600 | 490 | -- | -- | 5.67 | 1400 | 1700 |
| | 3/13/2024 | 3300 | 480 | 10 U | 1.0 U | 5.84 | 830 | 1300 |
| | 10/2/2024 | 390 | 190 | 20 U | 2.0 U | 6.92 | 950 | 1400 |
| 12/9/2024 | 1700 | 290 | -- | -- | 6.01 | 540 | 940 | |

TABLE 1
DETECTION MONITORING LABORATORY RESULTS
Seminole Generating Station
Increment 1

| Monitoring Well | Sampling Date | Boron (µg/L) | Calcium (mg/L) | Chloride (mg/L) | Fluoride (mg/L) | pH (SU) | Sulfate (mg/L) | Total Dissolved Solids (mg/L) |
|-----------------|---------------|--------------|----------------|-----------------|-----------------|---------|----------------|-------------------------------|
| MW-22 | 10/12/2017 | 3650 | 411 | 19.6 | 0.02 U | 5.31 | 960 | 1590 |
| | 12/1/2017 | 932 | 222 | -- | -- | 5.88 | 550 | 858 |
| | 3/13/2018 | 1000 | 307 | 24 | 0.06U | 5.97 | 772 | 1090 |
| | 5/4/2018 | 4780 | 533 | 18.9 | -- | 6.47 | 1190 | 1880 |
| | 7/31/2018 | 1860 | 275 | 26.3 | 0.06 U | 5.64 | 696 | 1100 |
| | 9/14/2028 | 3190 | 486 | 17.2 | -- | 6.11 | 1090 | 1750 |
| | 2/8/2019 | 1600 | 300 | 67 | 0.050 U | 6.12 | 34 | 1100 |
| | 4/4/2019 | 1000 | 220 | 17 I | -- | 5.89 | -- | 840 |
| | 8/12/2019 | 860 | 190 | 16 I | 0.25 U | 5.99 | 510 | 810 |
| | 10/25/2019 | 530 | 260 | -- | -- | 6.13 | 570 | 910 |
| | 4/19/2020 | 1300 | 350 | 7.1 I | 0.5 U | 5.13 | 910 | 1400 |
| | 8/7/2020 | 1100 | 290 | -- | -- | 6.24 | 730 | 1200 |
| | 10/5/2020 | 710 | 310 | 23 I | 2.0 U | 6.33 | 780 | 1200 |
| | 12/4/2020 | 920 | 200 | -- | -- | 6.43 | 480 | 780 |
| | 4/2/2021 | 820 | 270 | 17 I | 1.0 U | 6.4 | 640 | 1100 |
| | 7/30/2021 | 640 | 97 | -- | -- | 6.32 | 200 V | 370 |
| | 12/2/2021 | 1300 | 310 | 20 U | 2.0 U | 6.49 | 600 | 937 |
| | 1/11/2022 | 1000 | 170 | -- | -- | 6.52 | 470 | 842 |
| | 6/27/2022 | 1300 I | 370 | 20 U | 2.0 U | 6.59 | 780 | 1310 |
| | 8/23/2022 | 2100 | 110 | -- | -- | 6.73 | 190 | 464 |
| | 10/31/2022 | 580 | 170 | 18 | 0.40 U | 6.65 | 250 | 590 |
| | 12/31/2022 | 810 | 190 | -- | -- | 6.58 | 310 | 660 |
| | 6/27/2023 | 2100 | 430 | 20 U | 2.0 U | 6.59 | 1000 | 1700 |
| | 8/22/2023 | 580 | 240 | 14 I | 1.0 U | 6.77 | 470 | 800 |
| | 10/12/2023 | 970 | 320 | 15 I | 1.0 U | 6.80 | 690 | 1100 |
| | 11/15/2023 | 1100 | 360 | -- | -- | 6.85 | 750 | 1200 |
| | 3/19/2024 | 1200 | 54 | 59 | 1.0 U | 6.81 | 1200 | 1300 |
| | 10/2/2024 | 670 | 170 | 15 I | 1.0 U | 7.10 | 390 | 680 |
| 12/10/2024 | 830 | 230 | -- | -- | 6.81 | 380 | 760 | |

Notes:
mg/L - milligrams per liter
µg/L - micrograms per liter
SU - standard units
U - Result less than method detection limit
I - Reported value is between method detection limit and practical quantification limit
V - Method blank contamination